



Sub-Metering Spatial Requirements
Installation regulations for individual Cold Water Sub-Meters require 150mm clearance from the centre of each meter to other meters, walls or pipework.
(Hot Water Meters require 200mm clearance centre to centre of other Hot Water Meters)

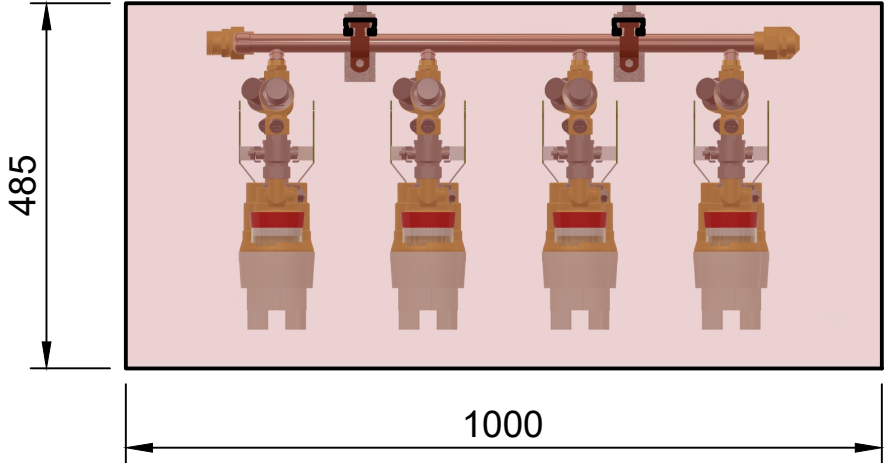

 SmartLink METERING SYSTEMS	Project SmartLink	Model No. SPATIAL	Date of issue 9/04/2025	
	Client	Description 7-8 Hot & Cold Water Sub-Metering Frame	Scale 1:10	
	Notes • All measurements are in mm.	Contact	Created by Arin de Mestre	Sheet 1/1
This drawing remains the property of deFOX Industries Pty Ltd and may not be reproduced in full or part without the written consent of deFOX Industries.				
Rev.				